


CITY OF GREENWOOD FIRE DEPARTMENT FIRE HYDRANT INSTALLATION DETAIL

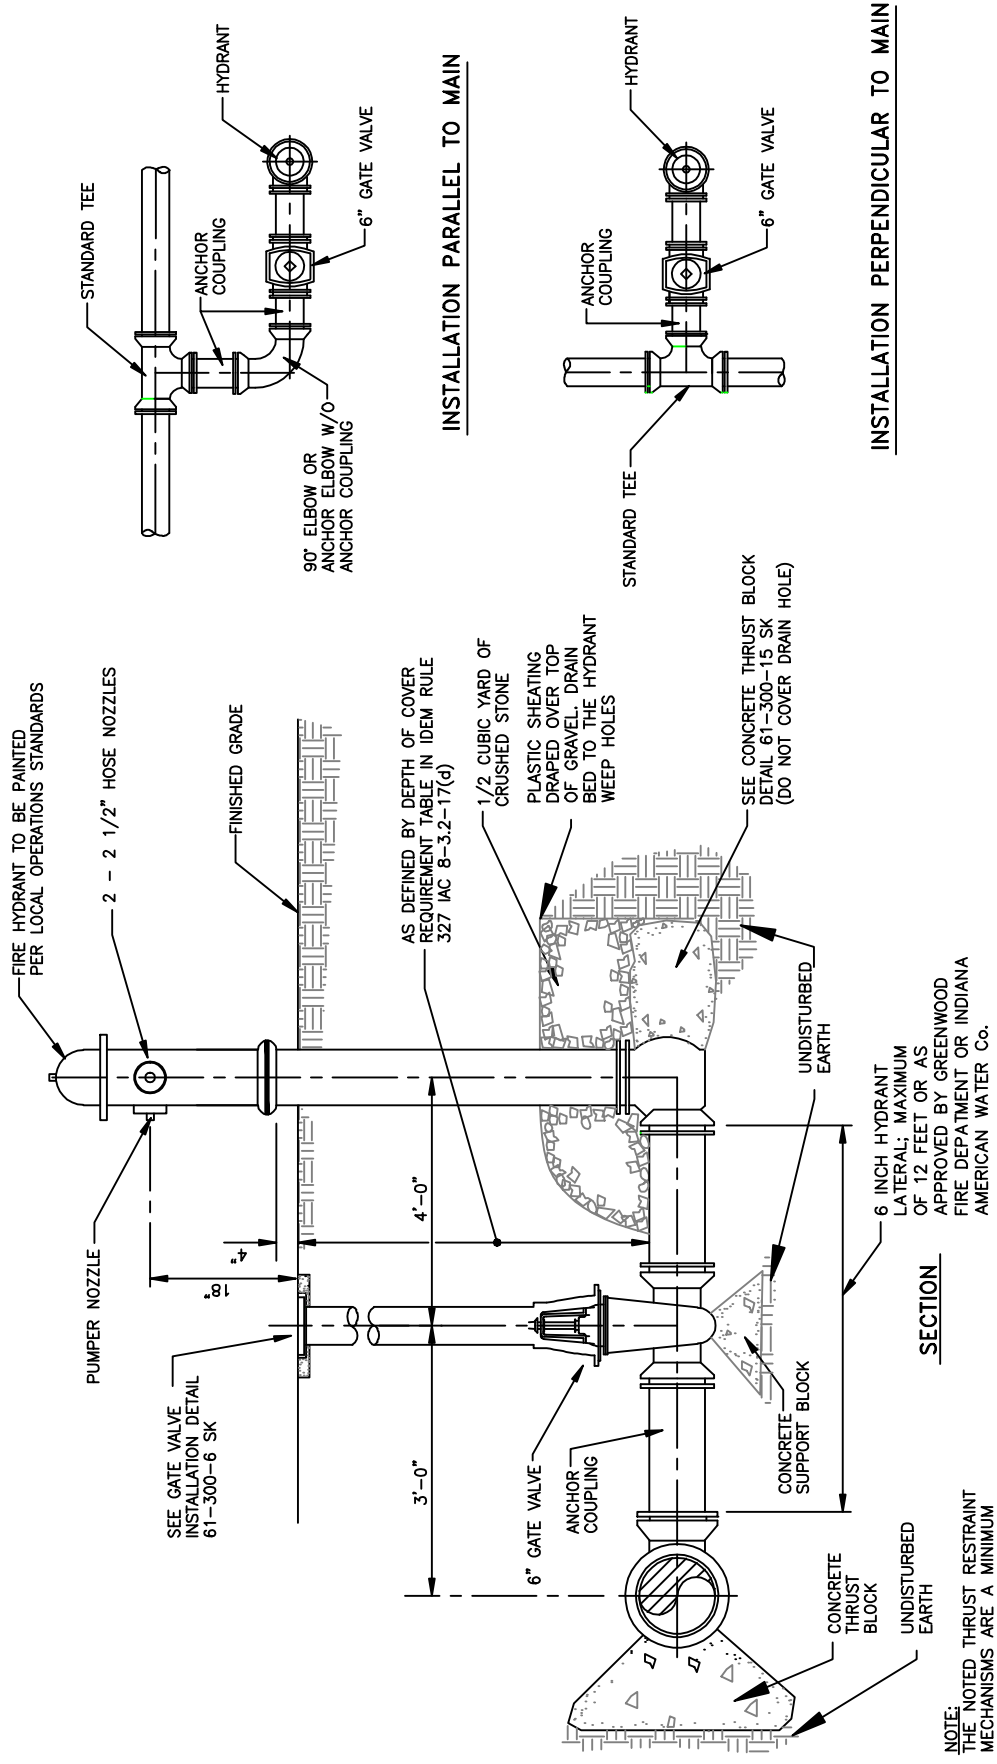

NOTE:
 THE NOTED THRUST RESTRAINT MECHANISMS ARE A MINIMUM RECOMMENDATION. LOCAL OPERATIONS SHALL OFFER PREFERENCES AND CONTRACTOR SHALL BE RESPONSIBLE FOR MEANS AND METHODS.